




Wall details shown for information only, not for construction issue

Please note:  
Wall build up to be certified by others.


82mm Maximum Projected wall thickness



FRONT VIEW



REAR VIEW




Maximum Threshold Height = 280mm


Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.

Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Rigid wall construction requirement is a minimum of 200mm between apertures. Minimum upstand in rigid standard wall construction 175mm. Outside of these minimum dimensions specific fire test evidence should be sought.

All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT [sales@selo-uk.com](mailto:sales@selo-uk.com)

				Remove all burrs and sharp edges.			FINISH:	N/A	COLOUR:	N/A	
				Please report errors and omissions		PROJECT:	QUADRA NULFIRE			TOLERANCES IN mm UNLESS OTHERWISE NOTED	
				MATERIAL:	N/A		INT DWG NO:	SEL-DRW-PRD-QUAD-5005			X ± 1
					NAME	DATE	EXT DWG NO:	N/A			X.X ±0.5
				DRAWN:	CK	15/05/23	DESCRIPTION:	Nulfire Projection Detail - Double Door Quadra			ANGULAR ±0.5 DEG
A	Initial issue	CK	15/05/23	CHECKED:							DO NOT SCALE PRINT
REV:	COMMENT:	REVISED BY:	DATE:	APPROVED:				SCALE:	1:16 @ A3	SHEET: 1 OF 2	MILLIMETERS

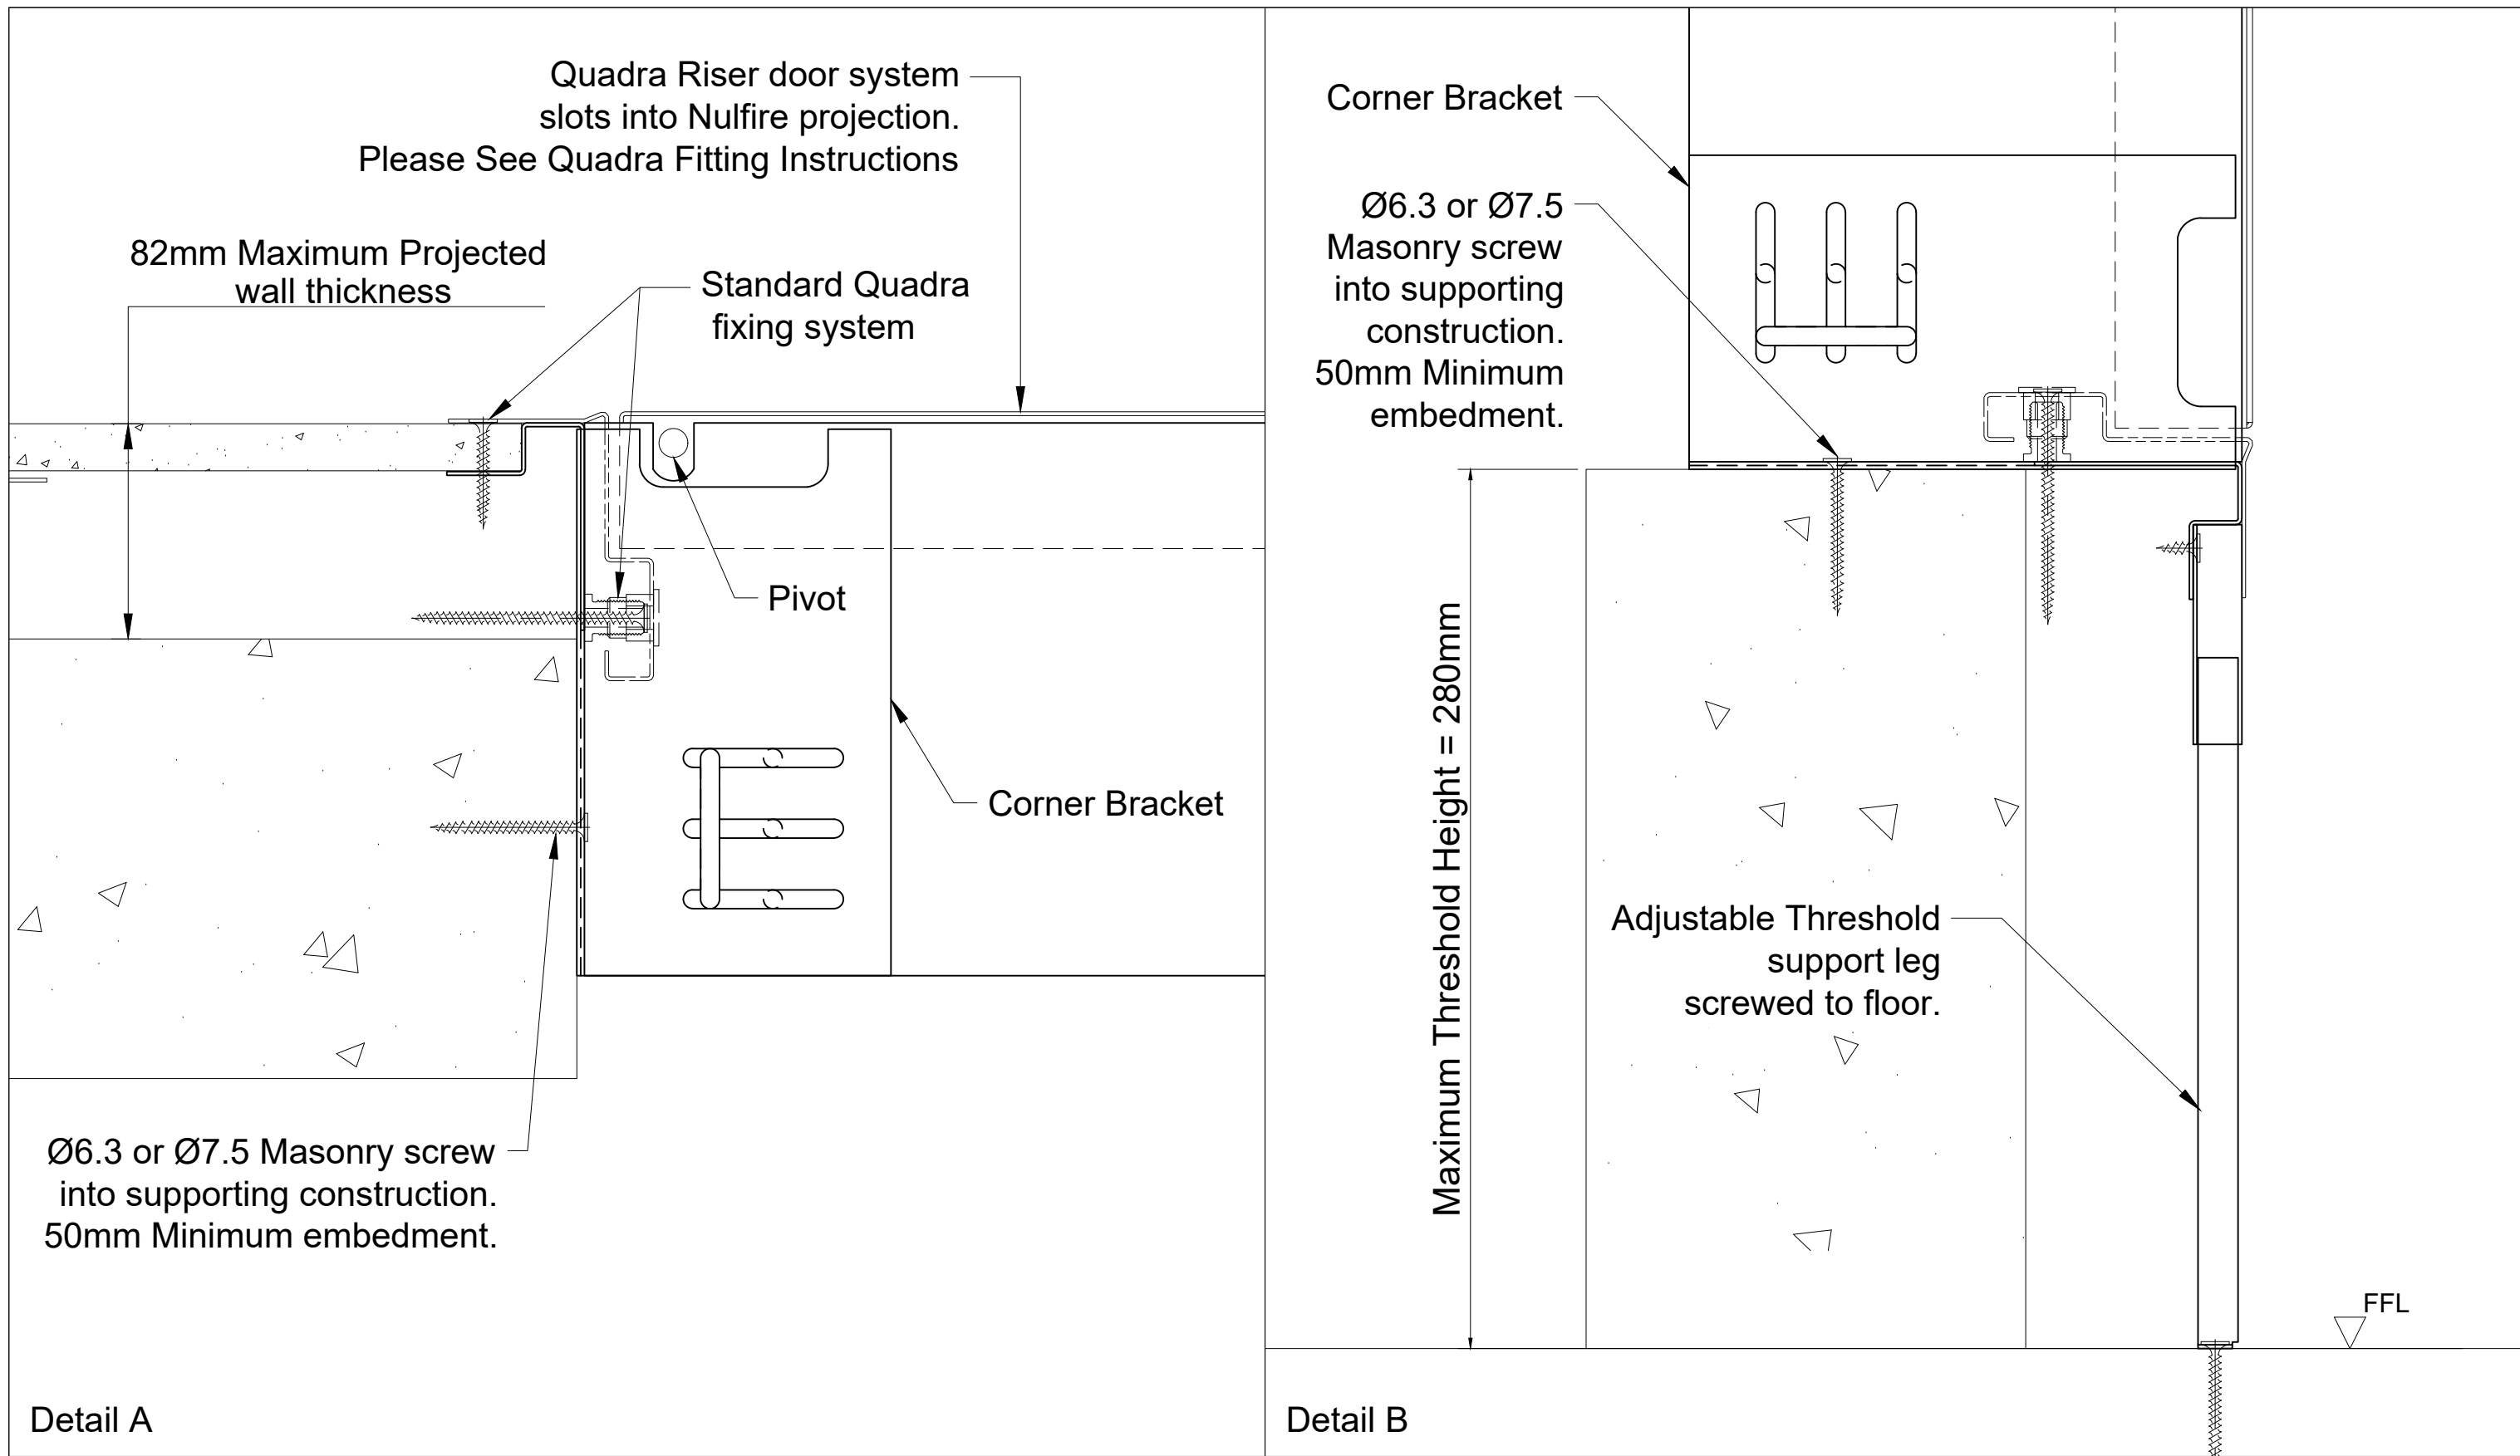


Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.

Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Rigid wall construction requirement is a minimum of 200mm between apertures. Minimum upstand in rigid standard wall construction 100mm. Outside of these minimum dimensions specific fire test evidence should be sought.

All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT [sales@selo-uk.com](mailto:sales@selo-uk.com)

				Remove all burrs and sharp edges.				FINISH:	N/A	COLOUR:	N/A		
				Please report errors and omissions			PROJECT:	QUADRA NULFIRE					
				MATERIAL:	N/A		INT DWG NO:	SEL-DRW-PRD-QUAD-5005					
					NAME	DATE	EXT DWG NO:	N/A					
				DRAWN:	CK	15/05/23	DESCRIPTION:	Nulfire Projection Detail - Double Door Quadra					
A	Initial issue	CK	15/05/23	CHECKED:				SCALE: 1:2 @ A3		SHEET: 2 OF 2			
REV:	COMMENT:	REVISED BY:	DATE:	APPROVED:									
							