
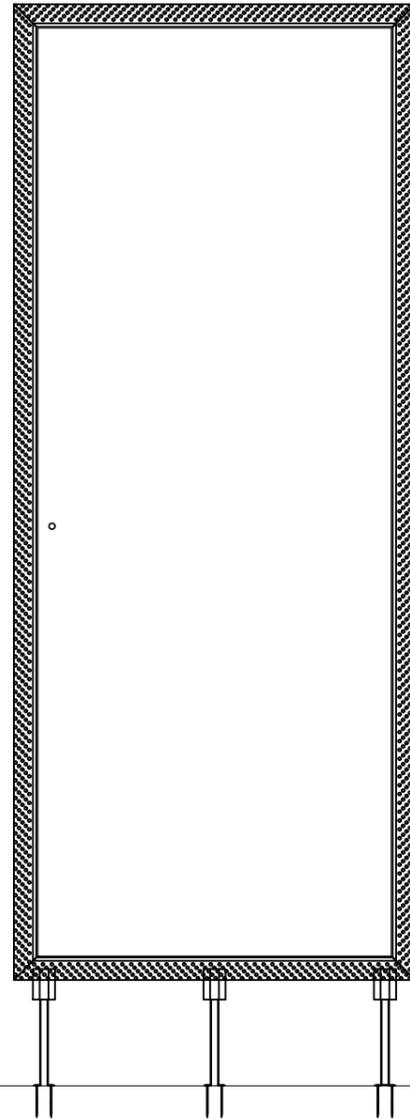



Wall details shown for information only, not for construction issue

Please note:
Wall build up to be certified by others.


82mm Maximum Projected wall thickness

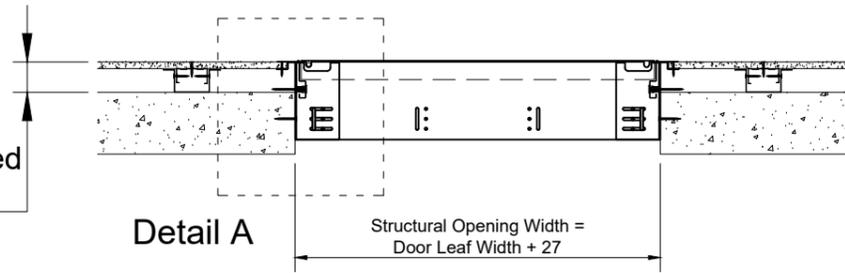

FRONT VIEW

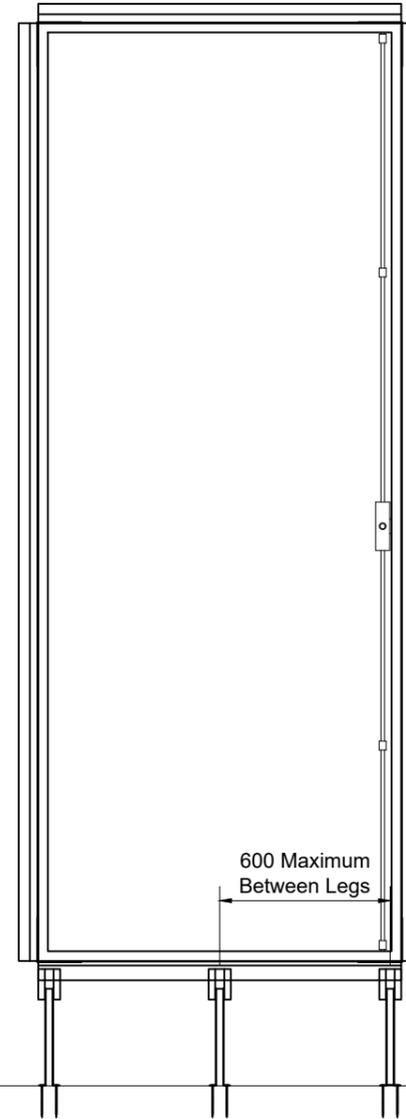

REAR VIEW

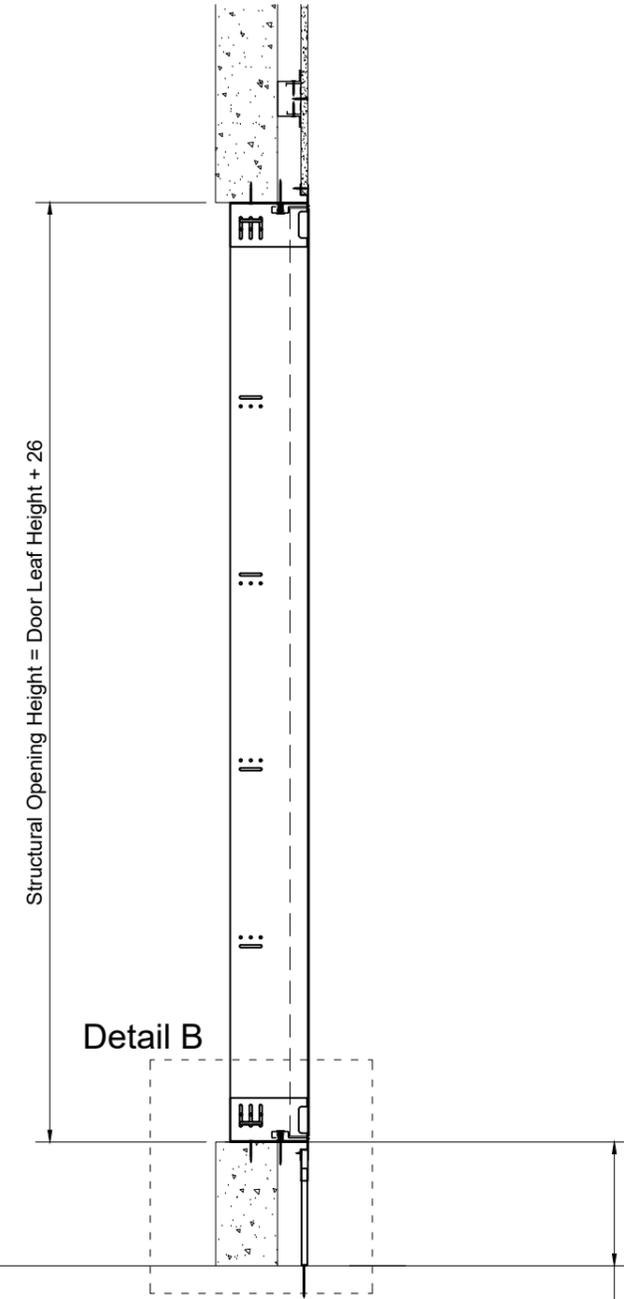



Detail B

Maximum Threshold Height = 280mm

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists. Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Rigid wall construction requirement is a minimum of 200mm between apertures. Minimum upstand in rigid standard wall construction 175mm. Outside of these minimum dimensions specific fire test evidence should be sought. All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE CONTACT THE SALES TEAM AT sales@selo-uk.com

		Remove all burrs and sharp edges.		FINISH:	N/A	COLOUR:	N/A
		Please report errors and omissions		PROJECT:	QUADRA NULFIRE	TOLERANCES IN mm UNLESS OTHERWISE NOTED	
MATERIAL:		N/A		INT DWG NO:	SEL-DRW-PRD-QUAD-5004	X	± 1
		NAME	DATE	EXT DWG NO:	N/A	X.X	±0.5
DRAWN:		CK	15/05/23	DESCRIPTION:	Nulfire Projection Detail - Single Door Quadra	ANGULAR	±0.5 DEG
A	Initial issue	CK	15/05/23	CHECKED:		DO NOT SCALE PRINT	
REV:	COMMENT:	REVISED BY:	DATE:	APPROVED:		MILLIMETERS	REV. A
					SCALE:	1:16 @ A3	SHEET: 1 OF 2

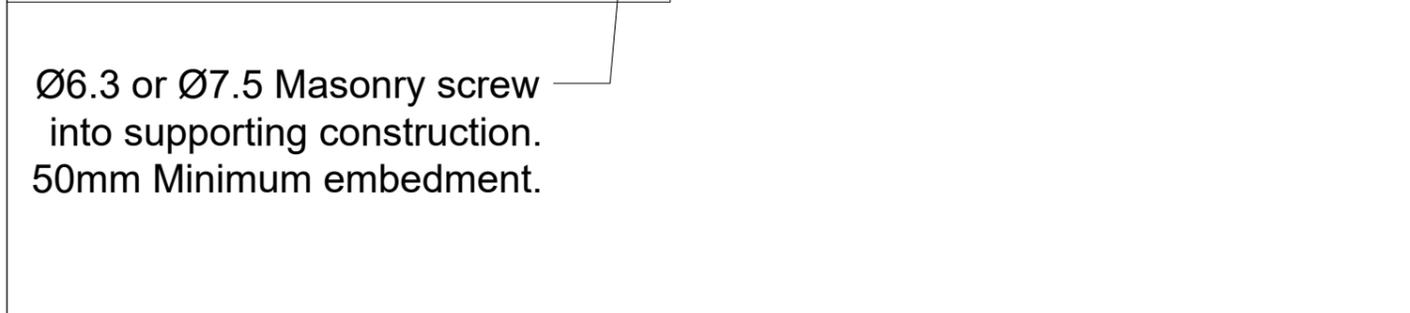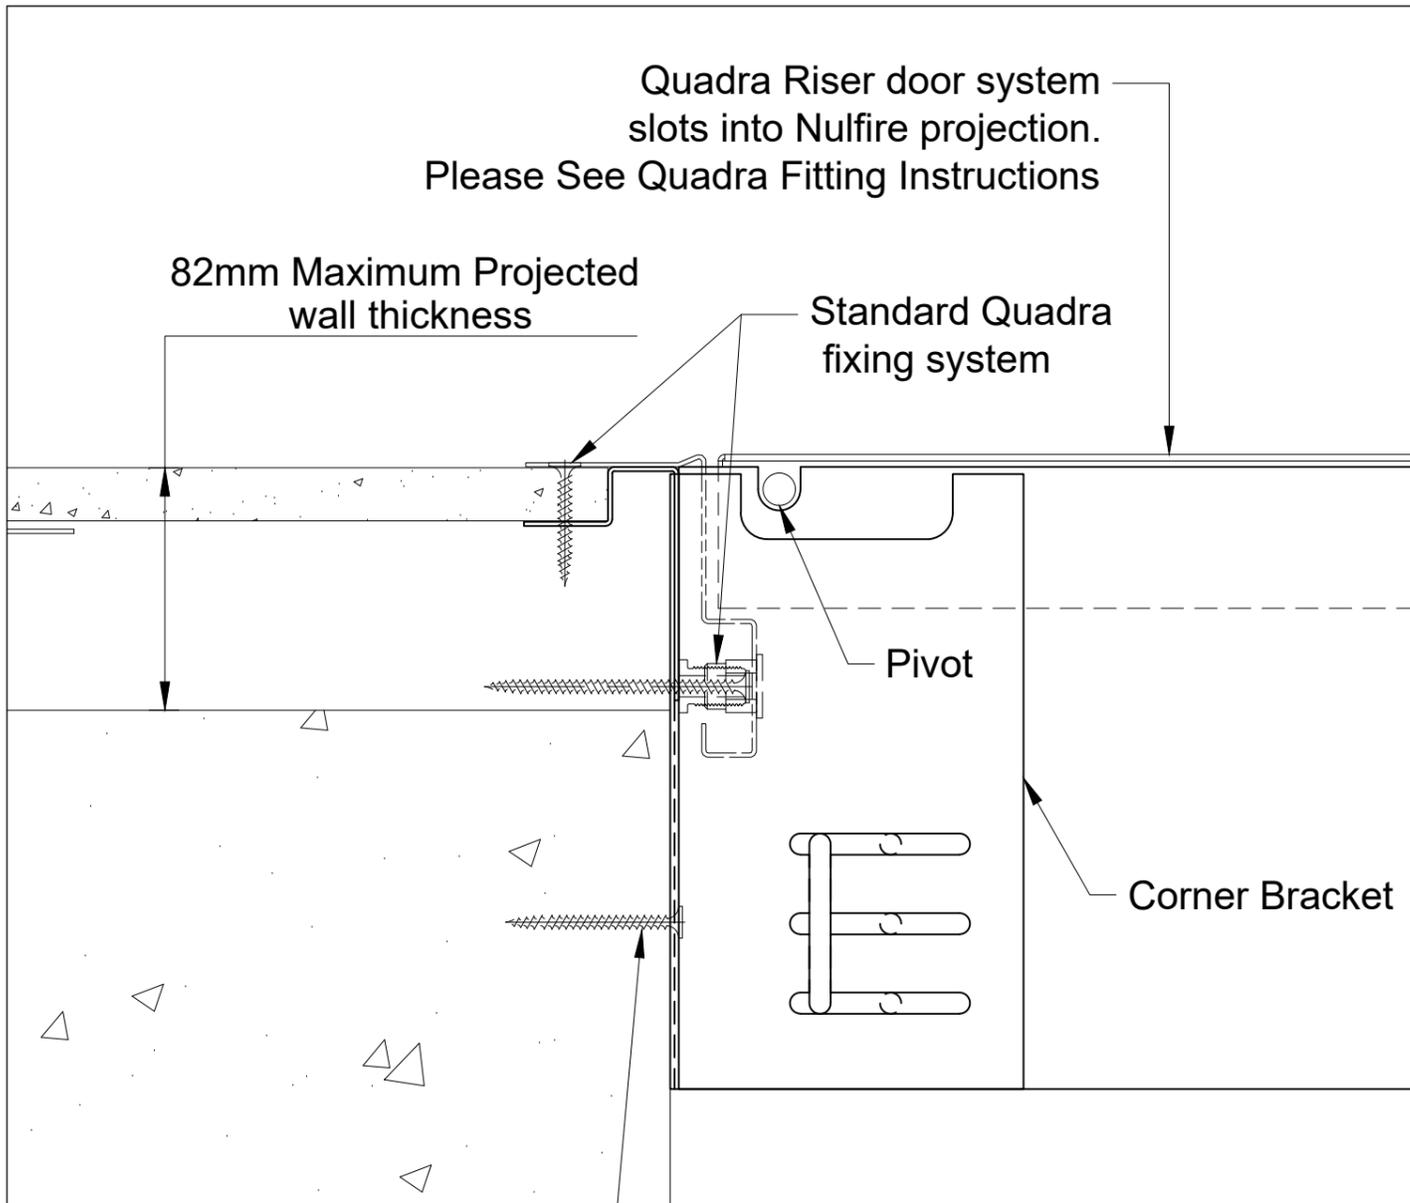

Detail A

Detail B

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.
 Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Rigid wall construction requirement is a minimum of 200mm between apertures. Minimum upstand in rigid standard wall construction 175mm. Outside of these minimum dimensions specific fire test evidence should be sought.
 All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE CONTACT THE SALES TEAM AT sales@selo-uk.com

				Remove all burrs and sharp edges.		FINISH: N/A	COLOUR: N/A
				Please report errors and omissions	PROJECT:	QUADRA NULFIRE	TOLERANCES IN mm UNLESS OTHERWISE NOTED
				MATERIAL: N/A	INT DWG NO:	SEL-DRW-PRD-QUAD-5004	X ±1 X.X ±0.5 ANGULAR ±0.5 DEG
					EXT DWG NO:	N/A	DO NOT SCALE PRINT
				DRAWN: CK 15/05/23	DESCRIPTION:	Nulfire Projection Detail - Single Door Quadra	MILLIMETERS
A	Initial issue	CK	15/05/23	CHECKED:			REV. A
REV:	COMMENT:	REVISED BY:	DATE:	APPROVED:		SCALE: 1:2 @ A3	SHEET: 2 OF 2