
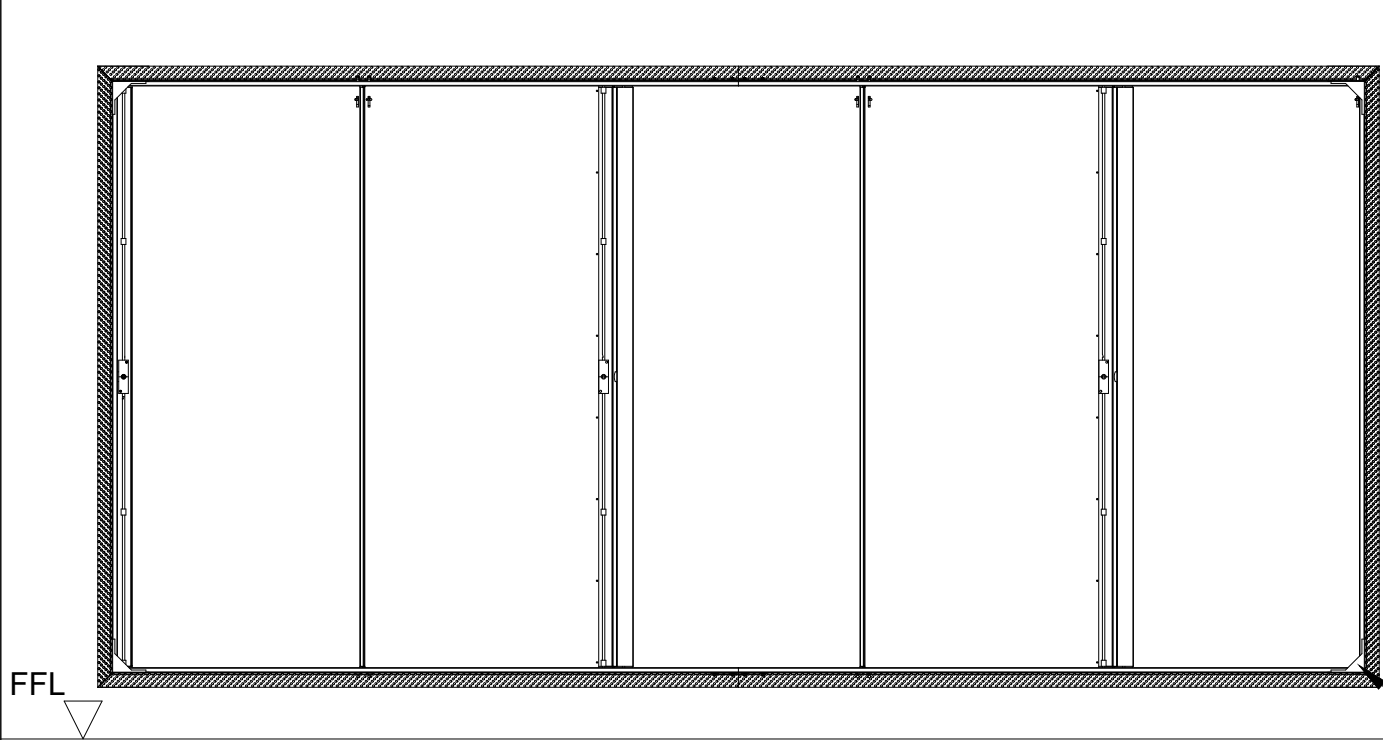


FIRE RATING	E120 E120Sa
FIRE STOPPING	INTUMESCENT ACRYLIC SEALANT or QUENCH FIRE-STOPPING
ACOUSTIC RATING	Up To 41dB
Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection.	


Drawing For Information Only
NOT FOR CONSTRUCTION

ABOVE TO BE SPECIFIED AS REQUIRED

Please note:
Wall build up to be certified by others.

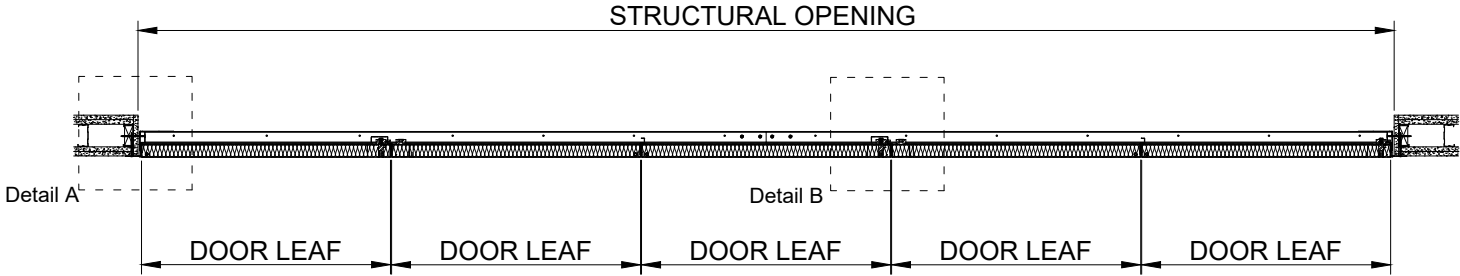

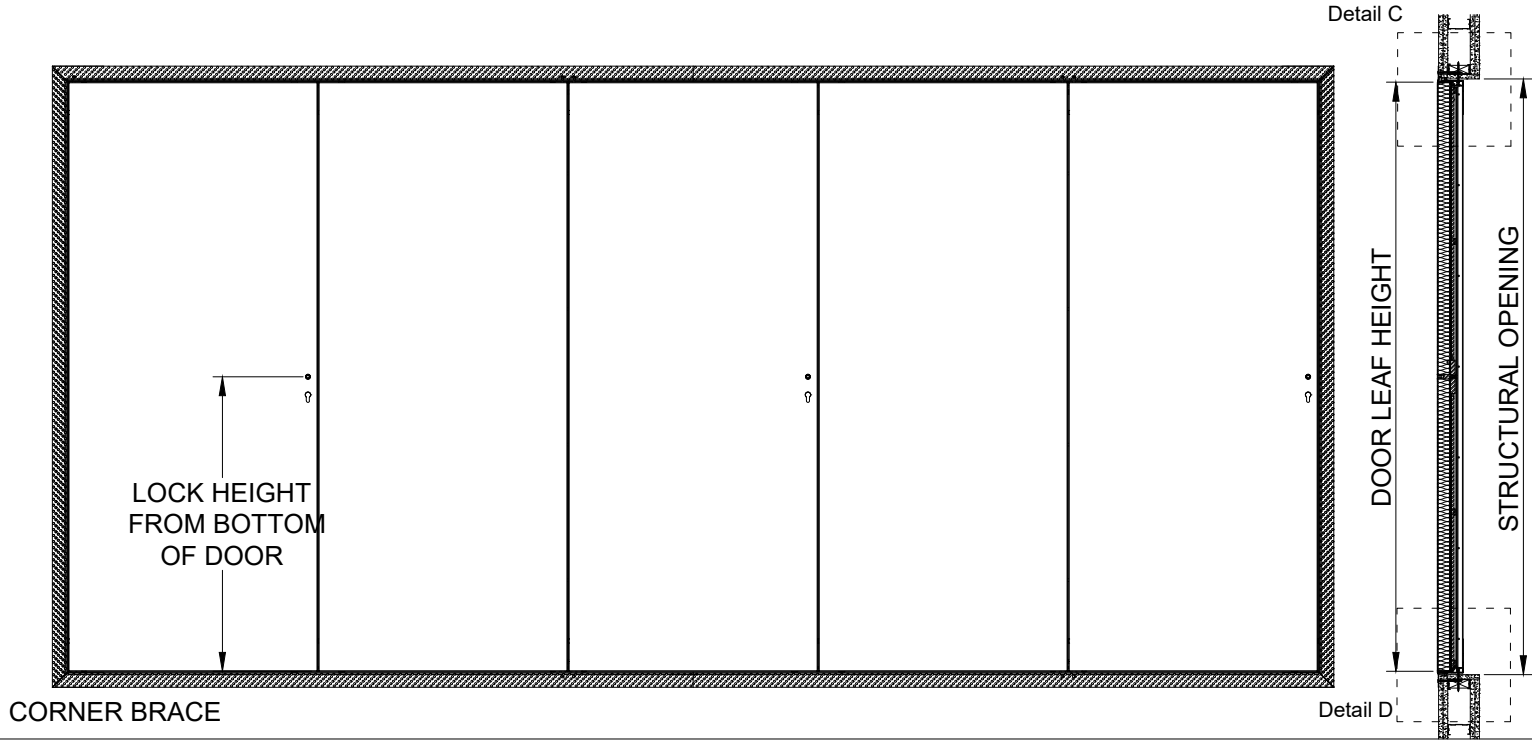

REAR VIEW



FRONT VIEW

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.
Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Minimum upstand in flexible standard wall construction 100mm. Outside of these minimum dimensions specific fire test evidence should be sought.
All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE
CONTACT THE SALES TEAM AT sales@selo-uk.com

Remove all burrs and sharp edges.	Please report errors and omissions		DO NOT SCALE PRINT		FINISH:	N/A	COLOUR:	N/A
DISCLAIMER:		MATERIAL:	N/A		PROJECT:		QUADRA - EURO CYLINDER	
Drawing is provided to customers free of charge and the details shown are subject to the accuracy of the information provided to SELO at the time the drawing was originally requested. No duty of care is owed to the recipient or any other third party and SELO cannot accept liability in respect to the details shown. The drawing should therefore be approved by the project design and management authority before use to ensure it meets with their specific requirements. It should also be read in conjunction with SELO's current literature available at www.selo-uk.com			NAME	DATE	DRAWING NUMBER:	SEL-DRW-PRD-QUAD-0021		TOLERANCES IN mm UNLESS OTHERWISE NOTED
		DRAWN	NB	30/03/21	TYPE:	RISER SYSTEM CONCEALED FRAME		
		CHECKED			PART DESCRIPTION:	FIVE DOOR - R5D LHA		
		APPROVED						
		REVISION	D			SCALE: N/A SHEET 1 OF 2		
						MILLIMETERS		

FIRE RATING	E120 E120Sa
FIRE STOPPING	INTUMESCENT ACRYLIC SEALANT or QUENCH FIRE-STOPPING
ACOUSTIC RATING	Up To 41dB
Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection.	


ABOVE TO BE SPECIFIED AS REQUIRED

Please note:
Wall build up to be certified by others.


Drawing For Information Only
NOT FOR CONSTRUCTION

FIRE STOPPING
TO BE SPECIFIED.
TO BE ADDED TO
ALL 4 SIDES WHERE
THE QUADRA RISER
MEETS THE WALL


70
FROM FACE OF DOOR
TO FIXING POINTS

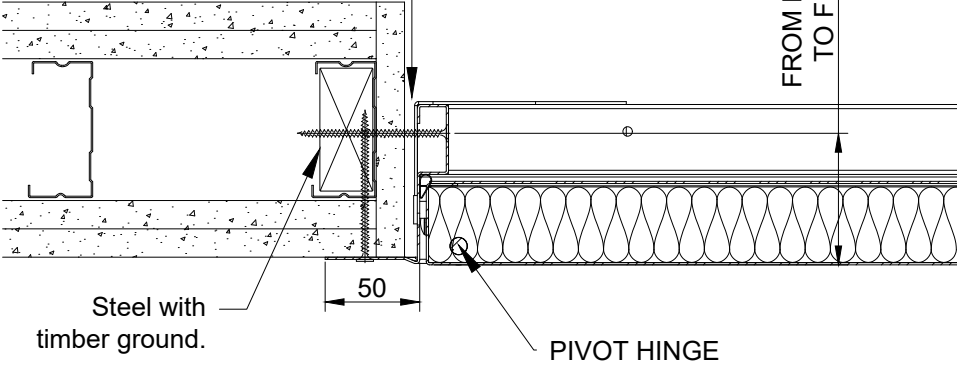


Detail A

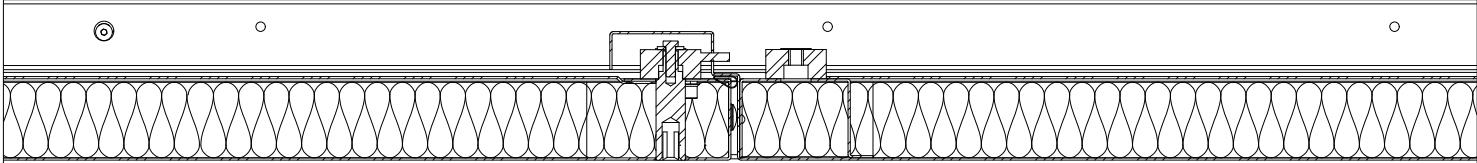

Detail B

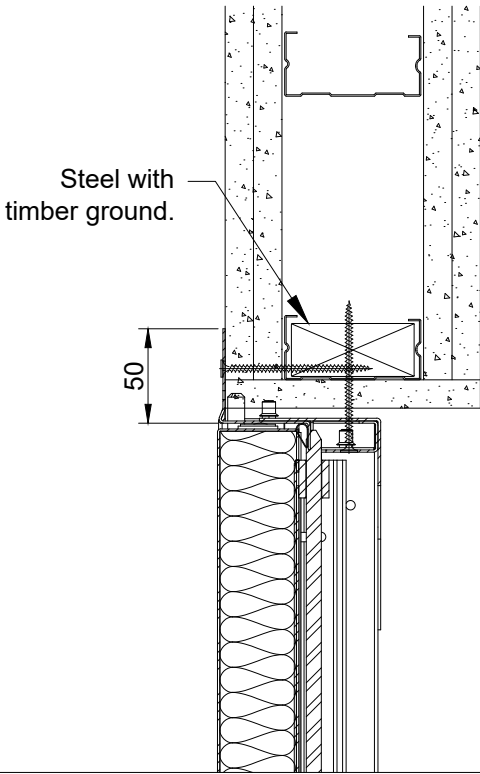


Detail C

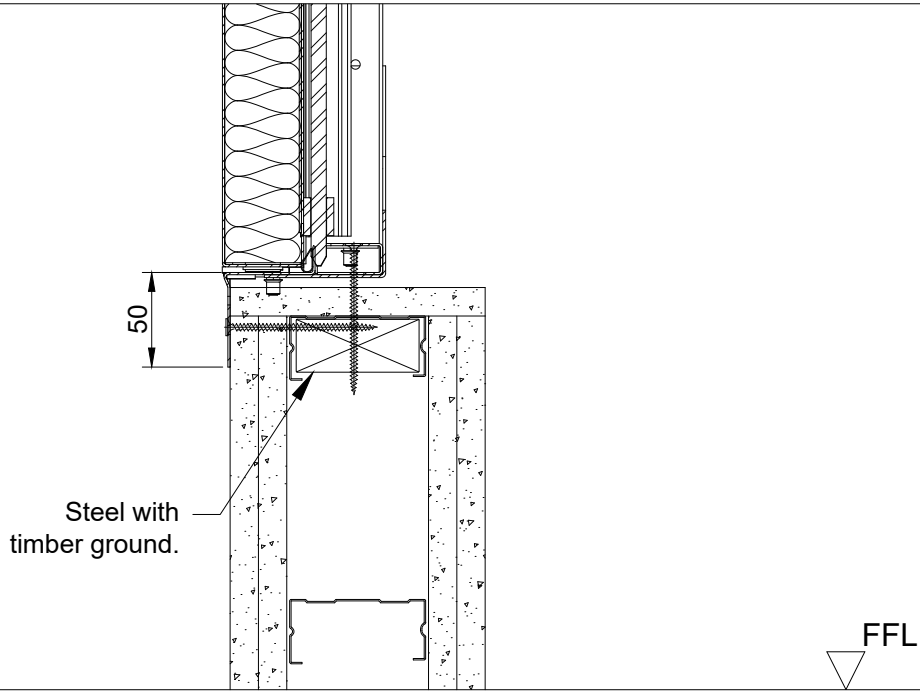

Detail D

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.
Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Minimum upstand in flexible standard wall construction 100mm. Outside of these minimum dimensions specific fire test evidence should be sought.
All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE
CONTACT THE SALES TEAM AT sales@selo-uk.com

Remove all burrs and sharp edges.		Please report errors and omissions		DO NOT SCALE PRINT		FINISH:		N/A		COLOUR:		N/A			
<p>DISCLAIMER:</p> <p>Drawing is provided to customers free of charge and the details shown are subject to the accuracy of the information provided to SELO at the time the drawing was originally requested. No duty of care is owed to the recipient or ant other third party and SELO cannot accept liability in respect to the details shown. The drawing should therefore be approved by the project design and management authority before use to ensure it meets with their specific requirements. It should also be read in conjunction with SELO's current literature available at www.selo-uk.com</p>			MATERIAL:		N/A		PROJECT:		QUADRA - EURO CYLINDER						
					NAME	DATE	DRAWING NUMBER:		SEL-DRW-PRD-QUAD-0021				TOLERANCES IN mm UNLESS OTHERWISE NOTED		
			DRAWN		NB	30/03/21	TYPE:		RISER SYSTEM CONCEALED FRAME						
			CHECKED				PART DESCRIPTION:		FIVE DOOR - R5D LHA				X	± 1	
			APPROVED									X.X	±0.5		
			REVISION		D			SCALE: N/A				SHEET 2 OF 2	MILLIMETERS	ANGULAR ±0.5 DEG	
															