
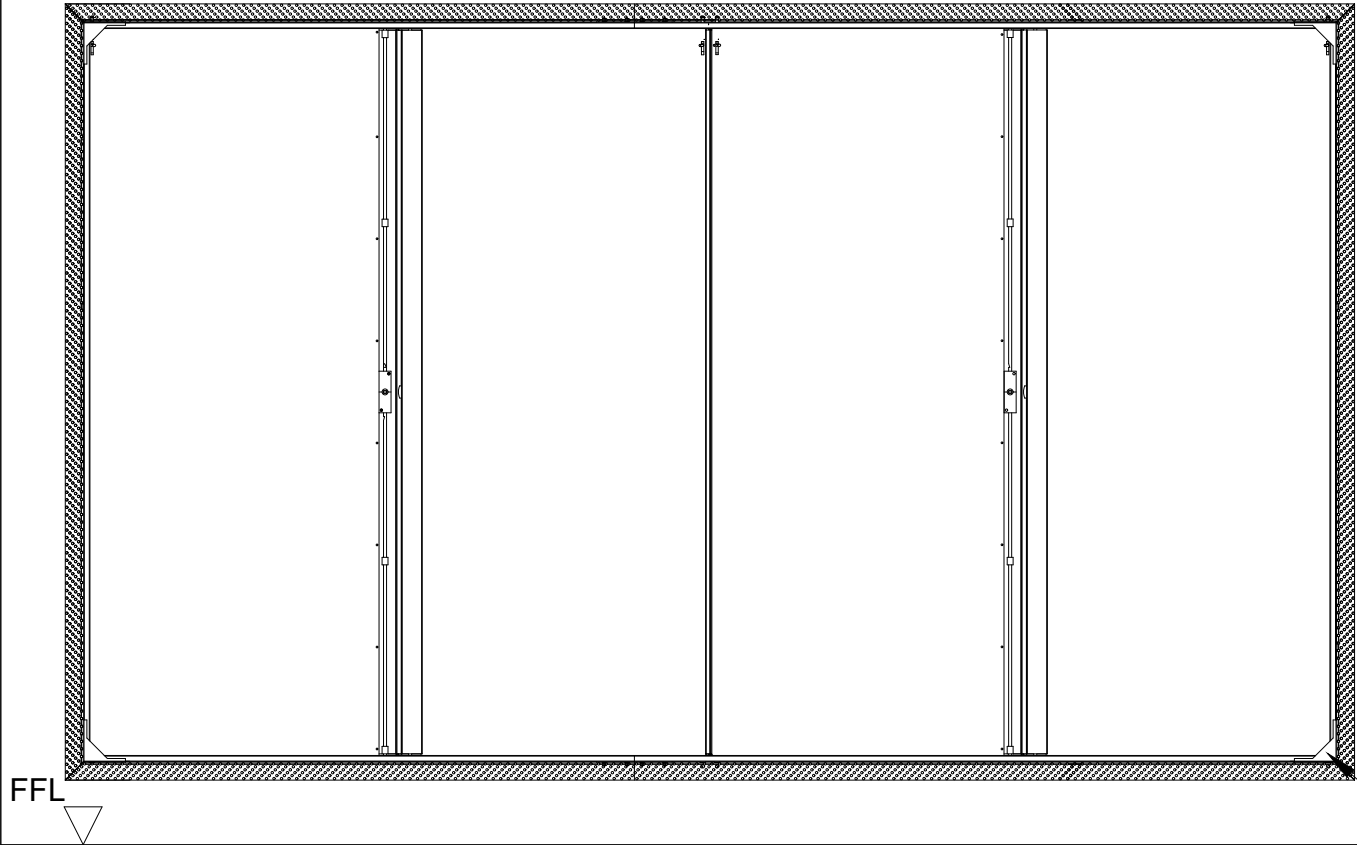


FIRE RATING	E120 E120Sa
FIRE STOPPING	INTUMESCENT ACRYLIC SEALANT or QUENCH FIRE-STOPPING
ACOUSTIC RATING	Up To 41dB
Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection.	


Drawing For Information Only  
NOT FOR CONSTRUCTION

ABOVE TO BE SPECIFIED AS REQUIRED

Please note:  
Wall build up to be certified by others.

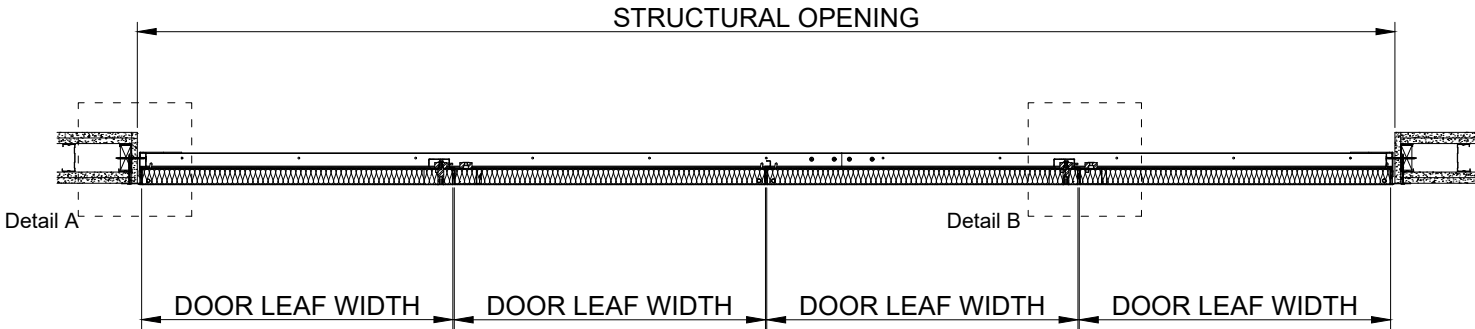

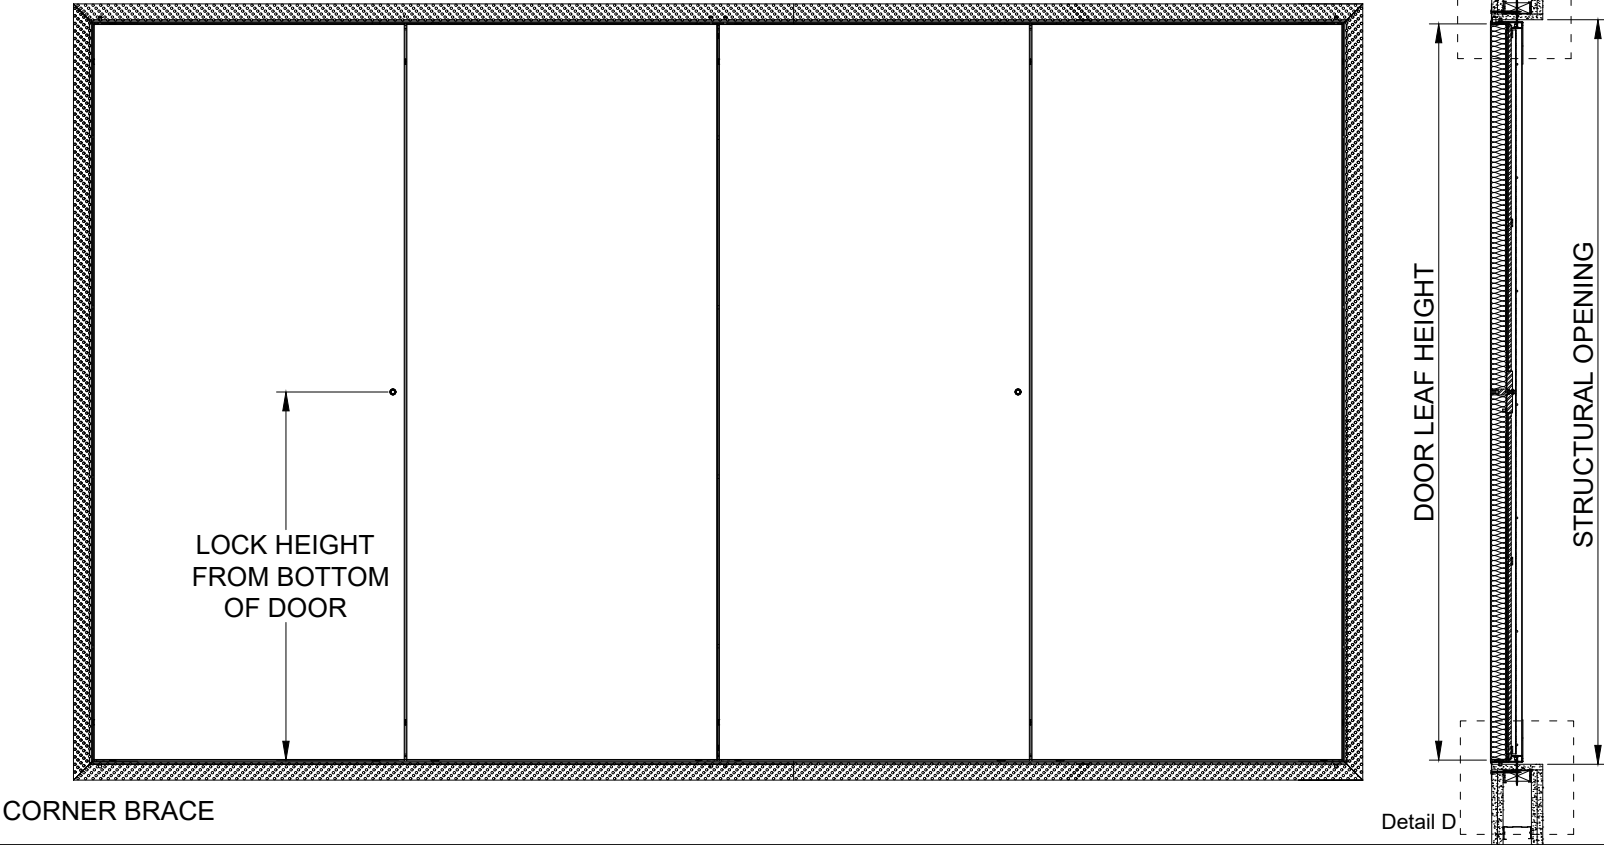

REAR VIEW



FRONT VIEW

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.  
Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Minimum upstand in flexible standard wall construction 100mm.  
Outside of these minimum dimensions specific fire test evidence should be sought.  
All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT [sales@selo-uk.com](mailto:sales@selo-uk.com)

Remove all burrs and sharp edges.		Please report errors and omissions		DO NOT SCALE PRINT		FINISH: N/A		COLOUR: N/A		
<p>DISCLAIMER:</p> <p>Drawing is provided to customers free of charge and the details shown are subject to the accuracy of the information provided to SELO at the time the drawing was originally requested. No duty of care is owed to the recipient or ant other third party and SELO cannot accept liability in respect to the details shown. The drawing should therefore be approved by the project design and management authority before use to ensure it meets with their specific requirements. It should also be read in conjunction with SELO's current literature available at <a href="http://www.selo-uk.com">www.selo-uk.com</a></p>		MATERIAL:	N/A		PROJECT:		QUADRA		TOLERANCES IN mm UNLESS OTHERWISE NOTED	
			NAME	DATE	DRAWING NUMBER:		SEL-DRW-PRD-QUAD-0008			
		DRAWN	NB	25/03/21	TYPE:		RISER SYSTEM CONCEALED FRAME			
		CHECKED			PART DESCRIPTION:		FOUR DOOR - 4D LHA		X ±1 X.X ±0.5 ANGULAR ±0.5 DEG	
		APPROVED				SCALE: N/A		SHEET 1 OF 2		MILLIMETERS 
		REVISION	D							

FIRE RATING	E120 E120Sa
FIRE STOPPING	INTUMESCENT ACRYLIC SEALANT or QUENCH FIRE-STOPPING
ACOUSTIC RATING	Up To 41dB
Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection.	


ABOVE TO BE SPECIFIED AS REQUIRED

Please note:  
Wall build up to be certified by others.


Drawing For Information Only  
NOT FOR CONSTRUCTION

FIRE STOPPING  
TO BE SPECIFIED.  
TO BE ADDED TO  
ALL 4 SIDES WHERE  
THE QUADRA RISER  
MEETS THE WALL


70  
FROM FACE OF DOOR  
TO FIXING POINTS

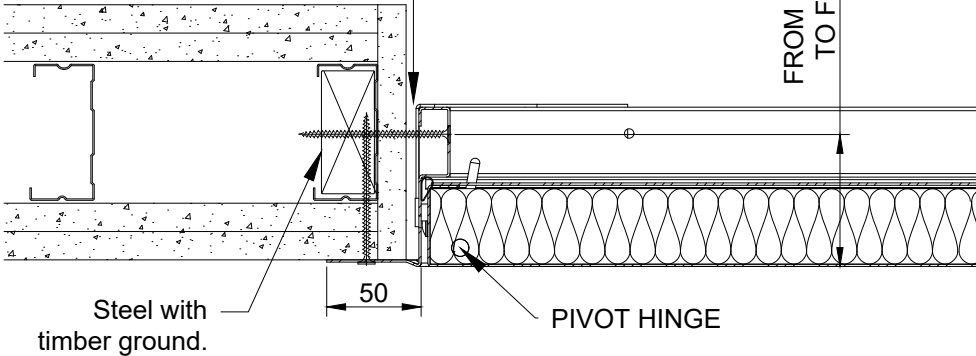


Detail A

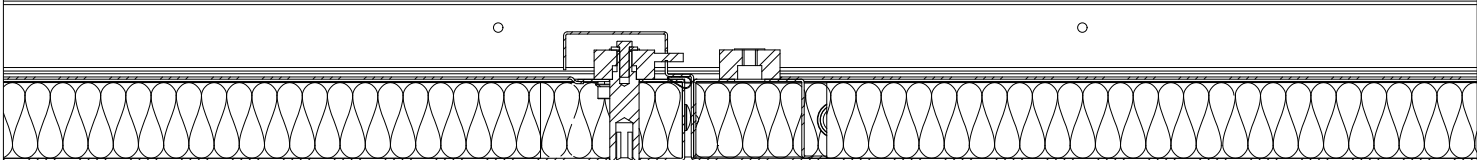

Detail B

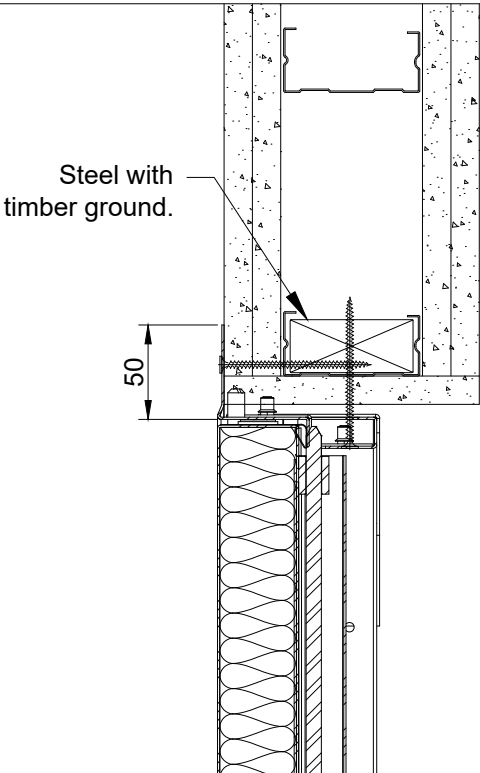


Detail C

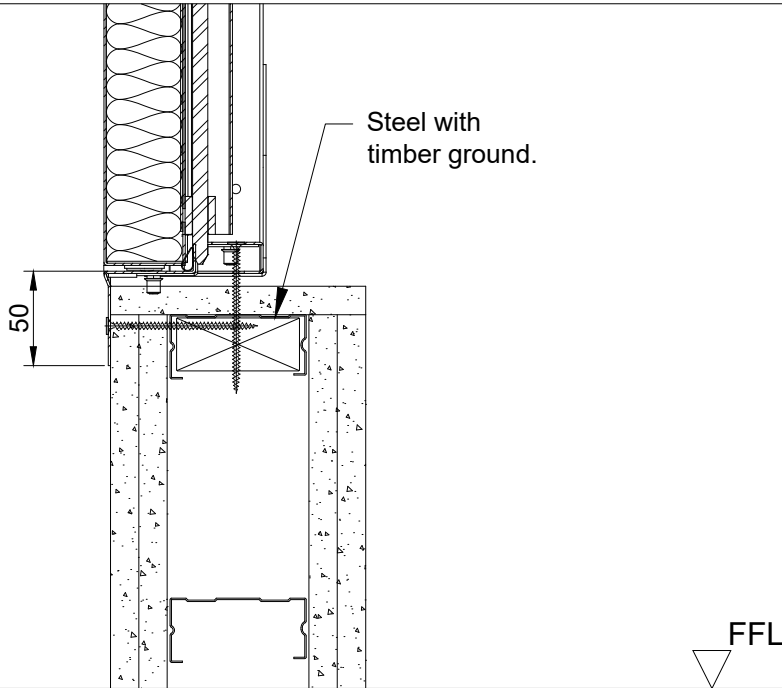

Detail D

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.  
Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Minimum upstand in flexible standard wall construction 100mm. Outside of these minimum dimensions specific fire test evidence should be sought.  
All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT [sales@selo-uk.com](mailto:sales@selo-uk.com)

Remove all burrs and sharp edges.		Please report errors and omissions		DO NOT SCALE PRINT		FINISH: N/A		COLOUR: N/A	
DISCLAIMER:		MATERIAL:		N/A		PROJECT:		QUADRA	
Drawing is provided to customers free of charge and the details shown are subject to the accuracy of the information provided to SELO at the time the drawing was originally requested. No duty of care is owed to the recipient or ant other third party and SELO cannot accept liability in respect to the details shown. The drawing should therefore be approved by the project design and management authority before use to ensure it meets with their specific requirements. It should also be read in conjunction with SELO's current literature available at <a href="http://www.selo-uk.com">www.selo-uk.com</a>				NAME		DATE		DRAWING NUMBER: SEL-DRW-PRD-QUAD-0008	
				DRAWN		NB		25/03/21	
				TYPE:		RISER SYSTEM CONCEALED FRAME		TOLERANCES IN mm UNLESS OTHERWISE NOTED  X ±1 X.X ±0.5 ANGULAR ±0.5 DEG	
				CHECKED		PART DESCRIPTION: FOUR DOOR - 4D LHA			
				APPROVED					
		REVISION		D				SCALE: N/A	
								SHEET 2 OF 2	
								MILLIMETERS 