
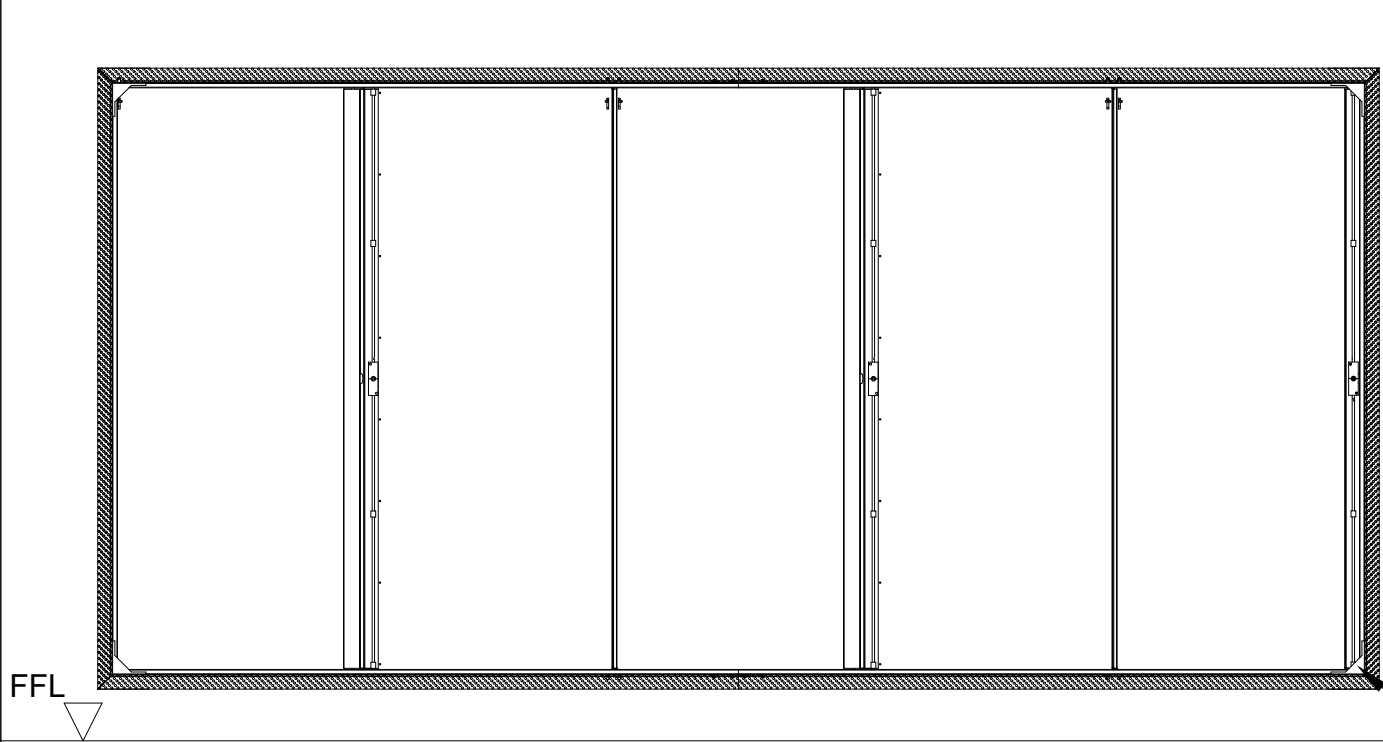


FIRE RATING	E120 E120Sa
FIRE STOPPING	INTUMESCENT ACRYLIC SEALANT or QUENCH FIRE-STOPPING
ACOUSTIC RATING	Up To 41dB
Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection.	


Drawing For Information Only  
NOT FOR CONSTRUCTION

ABOVE TO BE SPECIFIED AS REQUIRED

Please note:  
Wall build up to be certified by others.

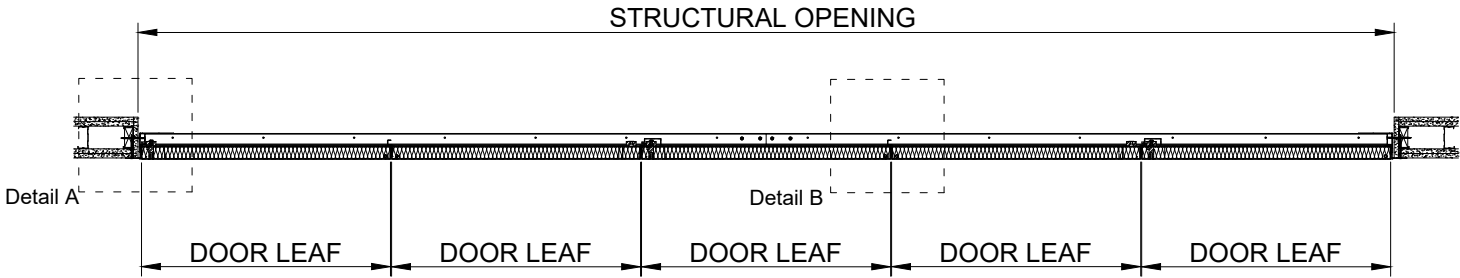


REAR VIEW

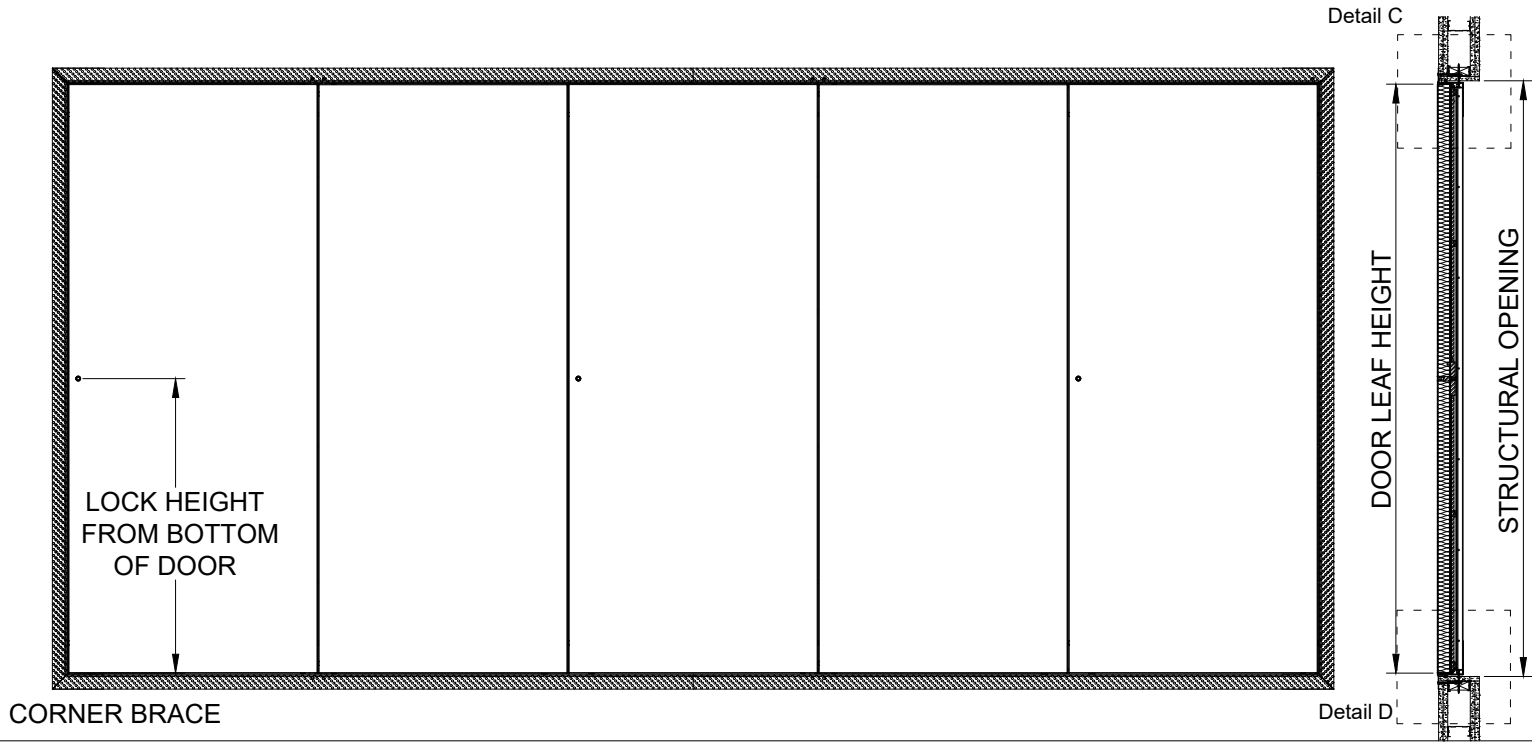

FRONT VIEW

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.  
Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Minimum upstand in flexible standard wall construction 100mm. Outside of these minimum dimensions specific fire test evidence should be sought.  
All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT [sales@selo-uk.com](mailto:sales@selo-uk.com)


Remove all burrs and sharp edges.		Please report errors and omissions		DO NOT SCALE PRINT		FINISH: N/A		COLOUR: N/A	
DISCLAIMER:		MATERIAL: N/A		PROJECT: QUADRA					
<p>Drawing is provided to customers free of charge and the details shown are subject to the accuracy of the information provided to SELO at the time the drawing was originally requested. No duty of care is owed to the recipient or any other third party and SELO cannot accept liability in respect to the details shown. The drawing should therefore be approved by the project design and management authority before use to ensure it meets with their specific requirements. It should also be read in conjunction with SELO's current literature available at <a href="http://www.selo-uk.com">www.selo-uk.com</a></p>				DRAWING NUMBER: SEL-DRW-PRD-QUAD-0010		TOLERANCES IN mm UNLESS OTHERWISE NOTED			
		NAME DATE							
		DRAWN NB 25/03/21		TYPE: RISER SYSTEM CONCEALED FRAME					
		CHECKED		PART DESCRIPTION: FIVE DOOR - L5D RHA		X ± 1 X.X ±0.5 ANGULAR ±0.5 DEG			
		APPROVED							
REVISION D		selo.		SCALE: N/A		SHEET 1 OF 2		MILLIMETERS 	

FIRE RATING	E120 E120Sa
FIRE STOPPING	INTUMESCENT ACRYLIC SEALANT or QUENCH FIRE-STOPPING
ACOUSTIC RATING	Up To 41dB
Results declared reflect the optimum achievable within the limitations of the test standard and sites specific average results may vary where building elements of different materials interface altering natural acoustic deflection.	

ABOVE TO BE SPECIFIED AS REQUIRED

Please note:  
Wall build up to be certified by others.

Detail A

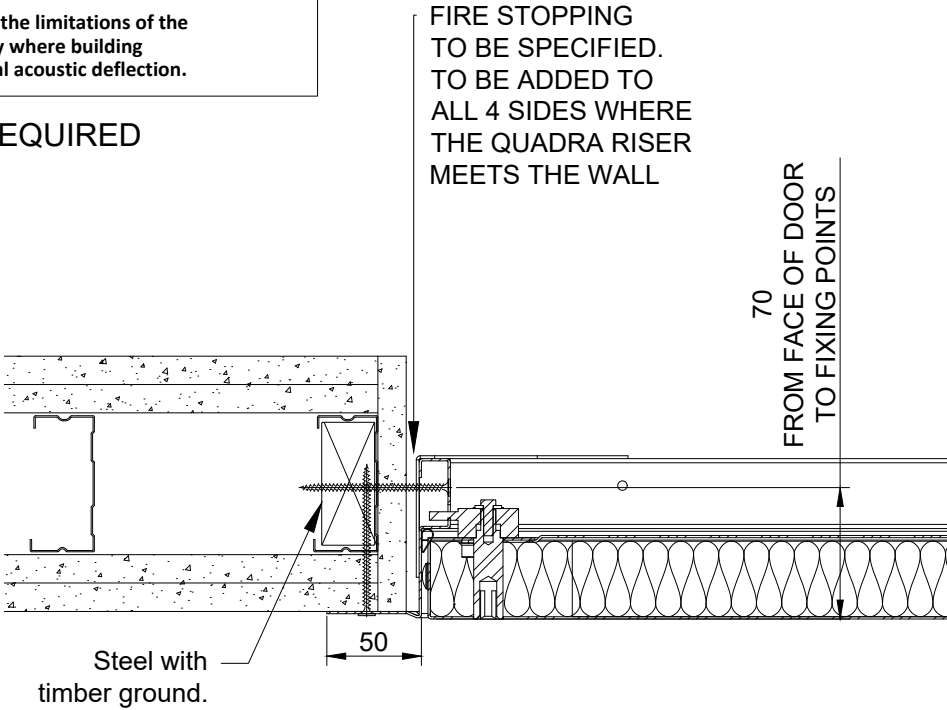

Drawing For Information Only  
NOT FOR CONSTRUCTION


FIRE STOPPING  
TO BE SPECIFIED.  
TO BE ADDED TO  
ALL 4 SIDES WHERE  
THE QUADRA RISER  
MEETS THE WALL

70  
FROM FACE OF DOOR  
TO FIXING POINTS

Steel with  
timber ground.

50


Detail B

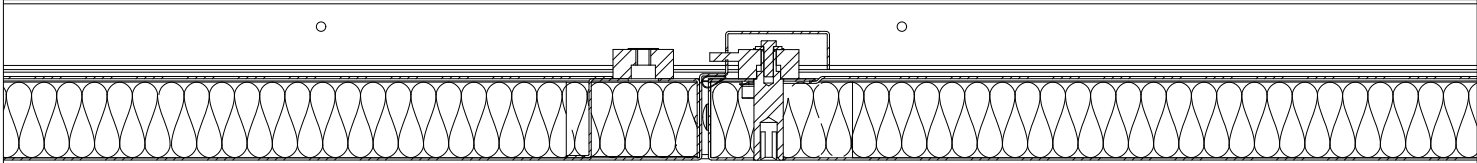

Steel with  
timber ground.

50


Detail C

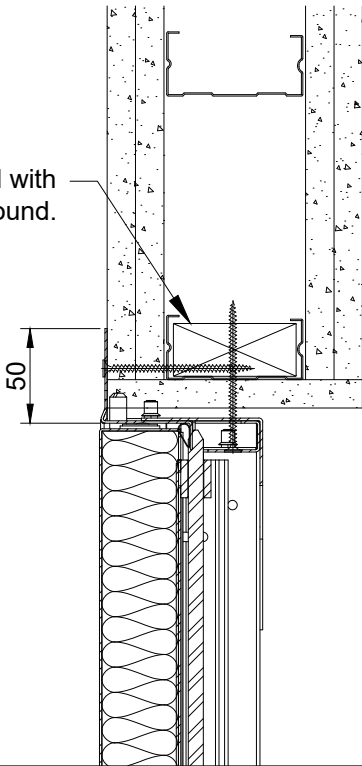

Steel with  
timber ground.

50

Detail D

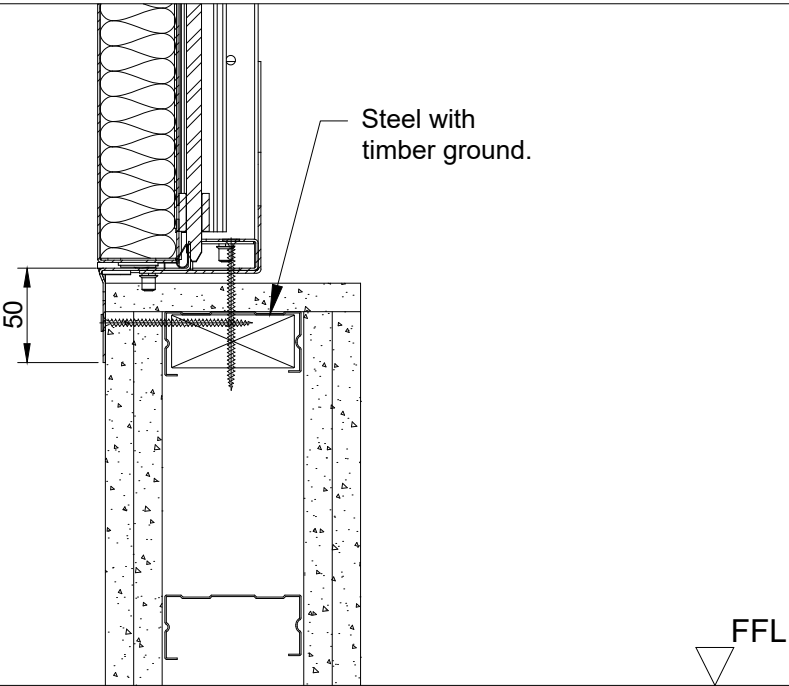

FFL

Selo are not the designers responsible for any wall detail if shown, you should know that we are not aware of any fire test evidence for wall constructions which are not, standard as defined in EN1363-1:2020, nor is it our responsibility to establish if such evidence exists.  
Tested detail in accordance with EN1634-1, requires standard supporting wall constructions with a minimum of 200mm either side and above door frame. Flexible wall construction requirement is a minimum of 300mm between apertures. Minimum upstand in flexible standard wall construction 100mm. Outside of these minimum dimensions specific fire test evidence should be sought.  
All requirements of the Fire resistance field of application report from Warringtonfire, for the Selo product/s included in this drawing must be ensured, or an alternative fire assessment for any deviation including non-standard wall details must be sought from a competent and designated body for producing fire resistance assessments.

FOR FURTHER TECHNICAL DETAIL AND INFORMATION PLEASE  
CONTACT THE SALES TEAM AT [sales@selo-uk.com](mailto:sales@selo-uk.com)

Remove all burrs and sharp edges.		Please report errors and omissions		DO NOT SCALE PRINT		FINISH: N/A		COLOUR: N/A	
DISCLAIMER:		MATERIAL: N/A		PROJECT: QUADRA					
<p>Drawing is provided to customers free of charge and the details shown are subject to the accuracy of the information provided to SELO at the time the drawing was originally requested. No duty of care is owed to the recipient or ant other third party and SELO cannot accept liability in respect to the details shown. The drawing should therefore be approved by the project design and management authority before use to ensure it meets with their specific requirements. It should also be read in conjunction with SELO's current literature available at <a href="http://www.selo-uk.com">www.selo-uk.com</a></p>				DRAWING NUMBER: SEL-DRW-PRD-QUAD-0010		TOLERANCES IN mm UNLESS OTHERWISE NOTED			
		NAME DATE							
		DRAWN NB 25/03/21		TYPE: RISER SYSTEM CONCEALED FRAME					
		CHECKED		PART DESCRIPTION: FIVE DOOR - L5D RHA		X ± 1 X.X ±0.5 ANGULAR ±0.5 DEG			
		APPROVED							
REVISION D		selo.		SCALE: N/A		SHEET 2 OF 2		MILLIMETERS	